
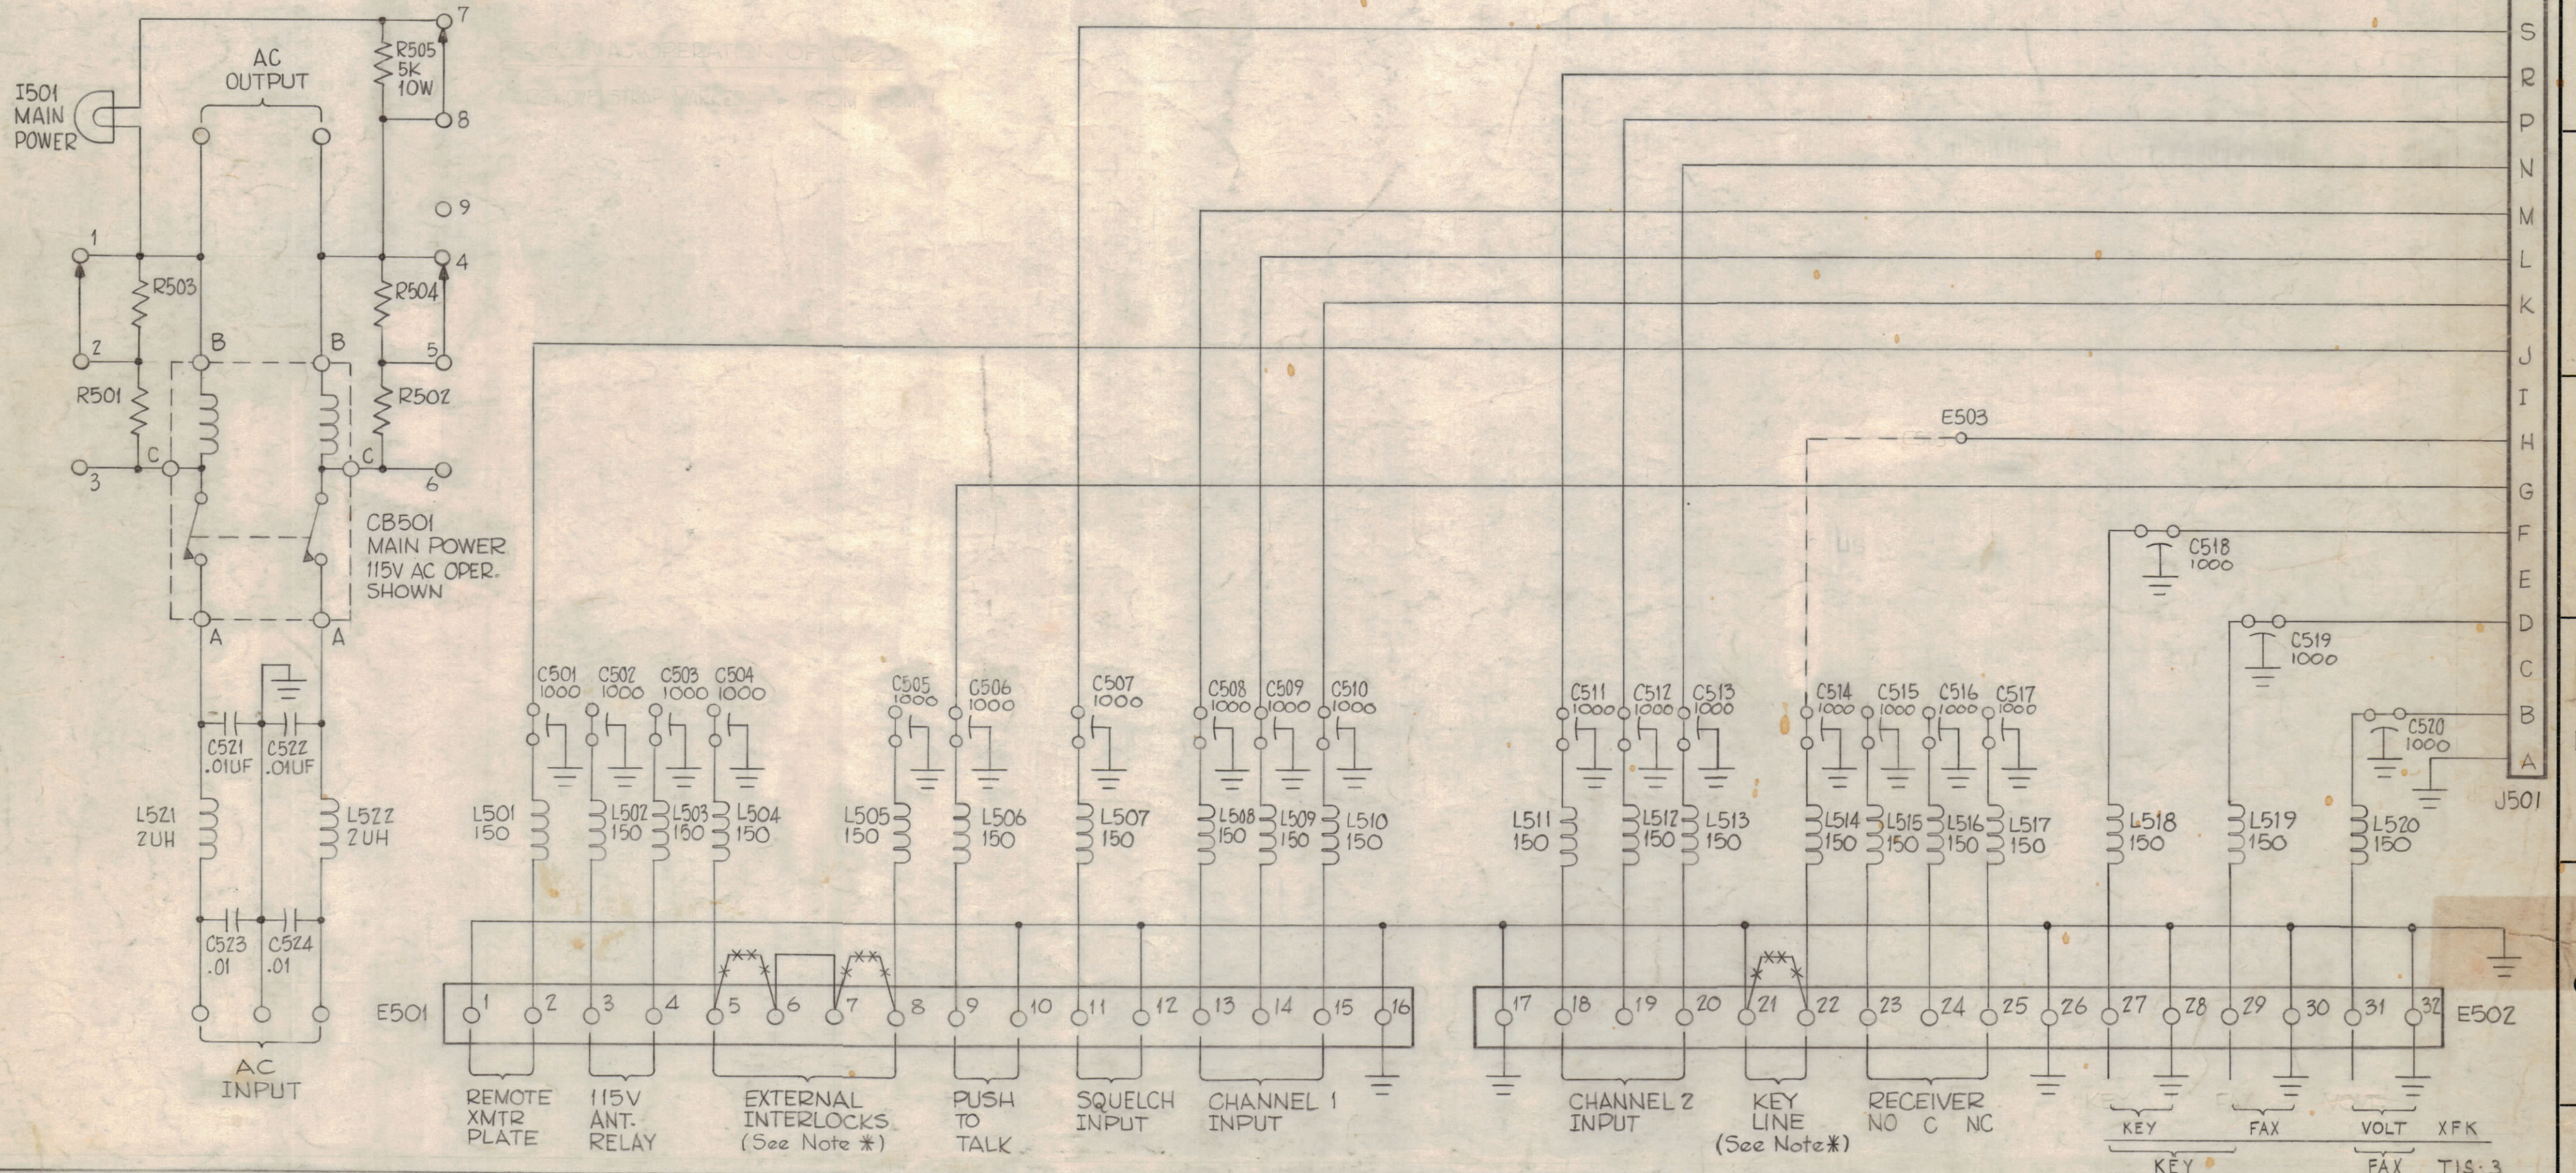


FOR 230VAC OPERATION OF CB-501

- 1- REMOVE STRAP MARKED → FROM TERMINAL 1, AND ATTACH TO TERMINAL 3.
- 2- " " " " " " " 4, " " " " " 6.
- 3- " " " " " " " 7, " " " " " 9.

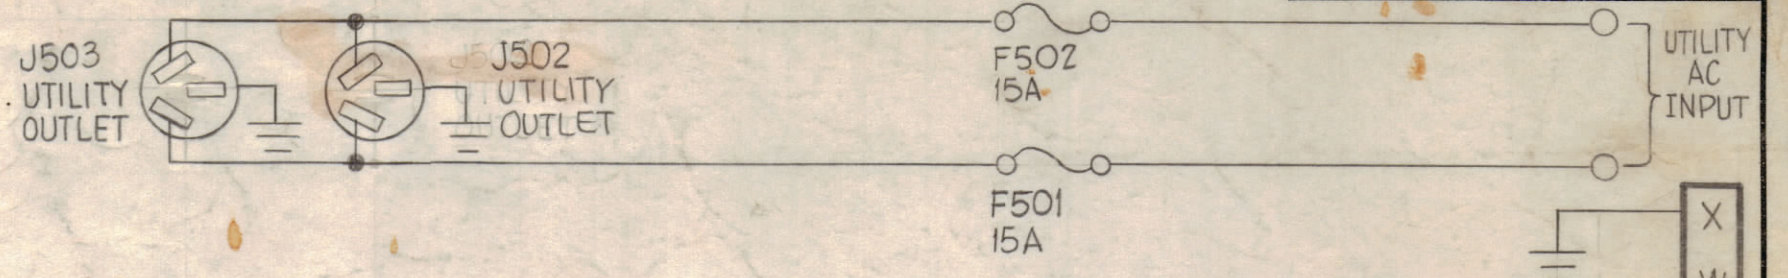

LAST SYMBOLS
 C524
 CB501
 E502
 I501
 J503
 L522
 R505

MISSING SYMBOLS

UNLESS OTHERWISE SPECIFIED:
 ALL CAPACITORS ARE IN MICRO-MICROFARADS.
 ALL COILS ARE IN MILLIHENRIES.

SYM	ZONE	DESCRIPTION	DATE	CH. NO.	DRAFTS	CHECKER	ENG. APP.
		ORIGINAL RELEASE FOR PRODUCTION	8-18-67			RG	
		EXP. RELEASE	8-8-67		X		

UNLESS OTHERWISE SPECIFIED:
 DIMENSIONS ARE IN INCHES
 TOLERANCES ON
 FRACTIONS ± 1/64 DECIMALS ± .005 ANGLES ± 1/2°

SCALE
 MAXIMUM ALLOWABLE TOLERANCES HAVE BEEN DETERMINED AND ANY DEVIATIONS WILL BE CAUSE FOR REJECTION. REMOVE ALL BURRS & SHARP EDGES

NOTE - * WHEN EXTERNAL INTERLOCKS AND/OR KEYLINE IS USED REMOVE JUMPERS MARKED *** FROM TERMINALS 5 & 6, 7 & 8 AND 21 & 22.

REQ. PER UNIT	APP-4B	MODEL	SECTION	ASS'Y. NO.	DATE
					12-8-60

REQ. ITEM	PART NO.	DESCRIPTION	SYMBOL
THE TECHNICAL MATERIEL CORP. MAMARONECK, NEW YORK			
DIAGRAM, SCHEMATIC (MODEL APP-4B)			
DRAWN		CHECKED	
TYPE & TEMPER		HEAT TREAT. SPEC.	
M/L			
FINISH & SPEC. NO.		ELEC. DES. APP.	
		MECH. DES. APP.	
		SHEET OF	
		CK1407	